


Ziegler


Redefine Innovative Metering

CONNECTION DIAGRAMS :

For Single Phase

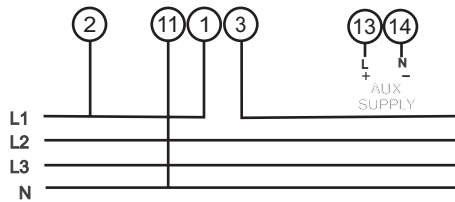


3 Phase 3 Wire Unbalanced Load

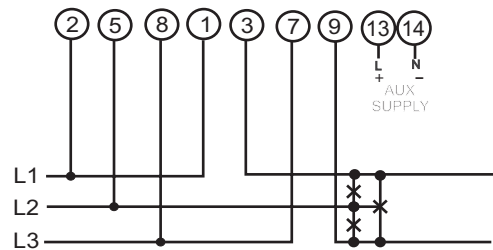



For Direct operated meter

3 Phase 4 Wire Unbalanced Load

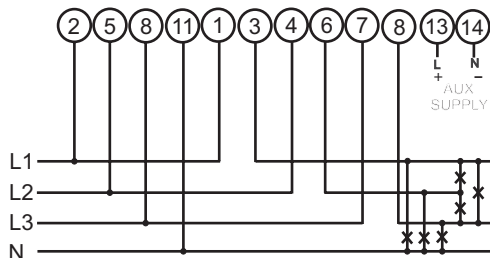

For Direct operated meter

DIMENSIONAL DIAGRAMS :

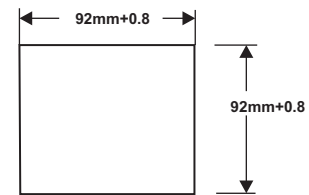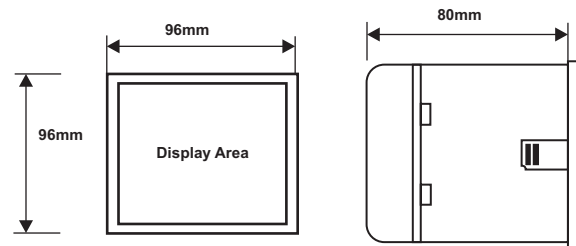

ORDERING INFORMATION

Please specify ordering information as given below,

Type	System	Voltage	Current	Aux. Supply	Digit Height
------	--------	---------	---------	-------------	--------------

ORDERING EXAMPLE

DPM-PF	3P4W	415V _{LL}	5A	230VAC	11
--------	------	--------------------	----	--------	----


It is recommended that the wires used for connections to the instrument should have lugs soldered at the end. That is, the connections should be made with Lugged wires for secure connections. The Maximum diameter of the lug should be 7.0mm and maximum thickness 3.5 mm.

Permissible cross section of the connection wires:

$\leq 4.0 \text{ mm}^2$ single wire or $2 \times 2.5 \text{ mm}^2$ fine wire



Ziegler

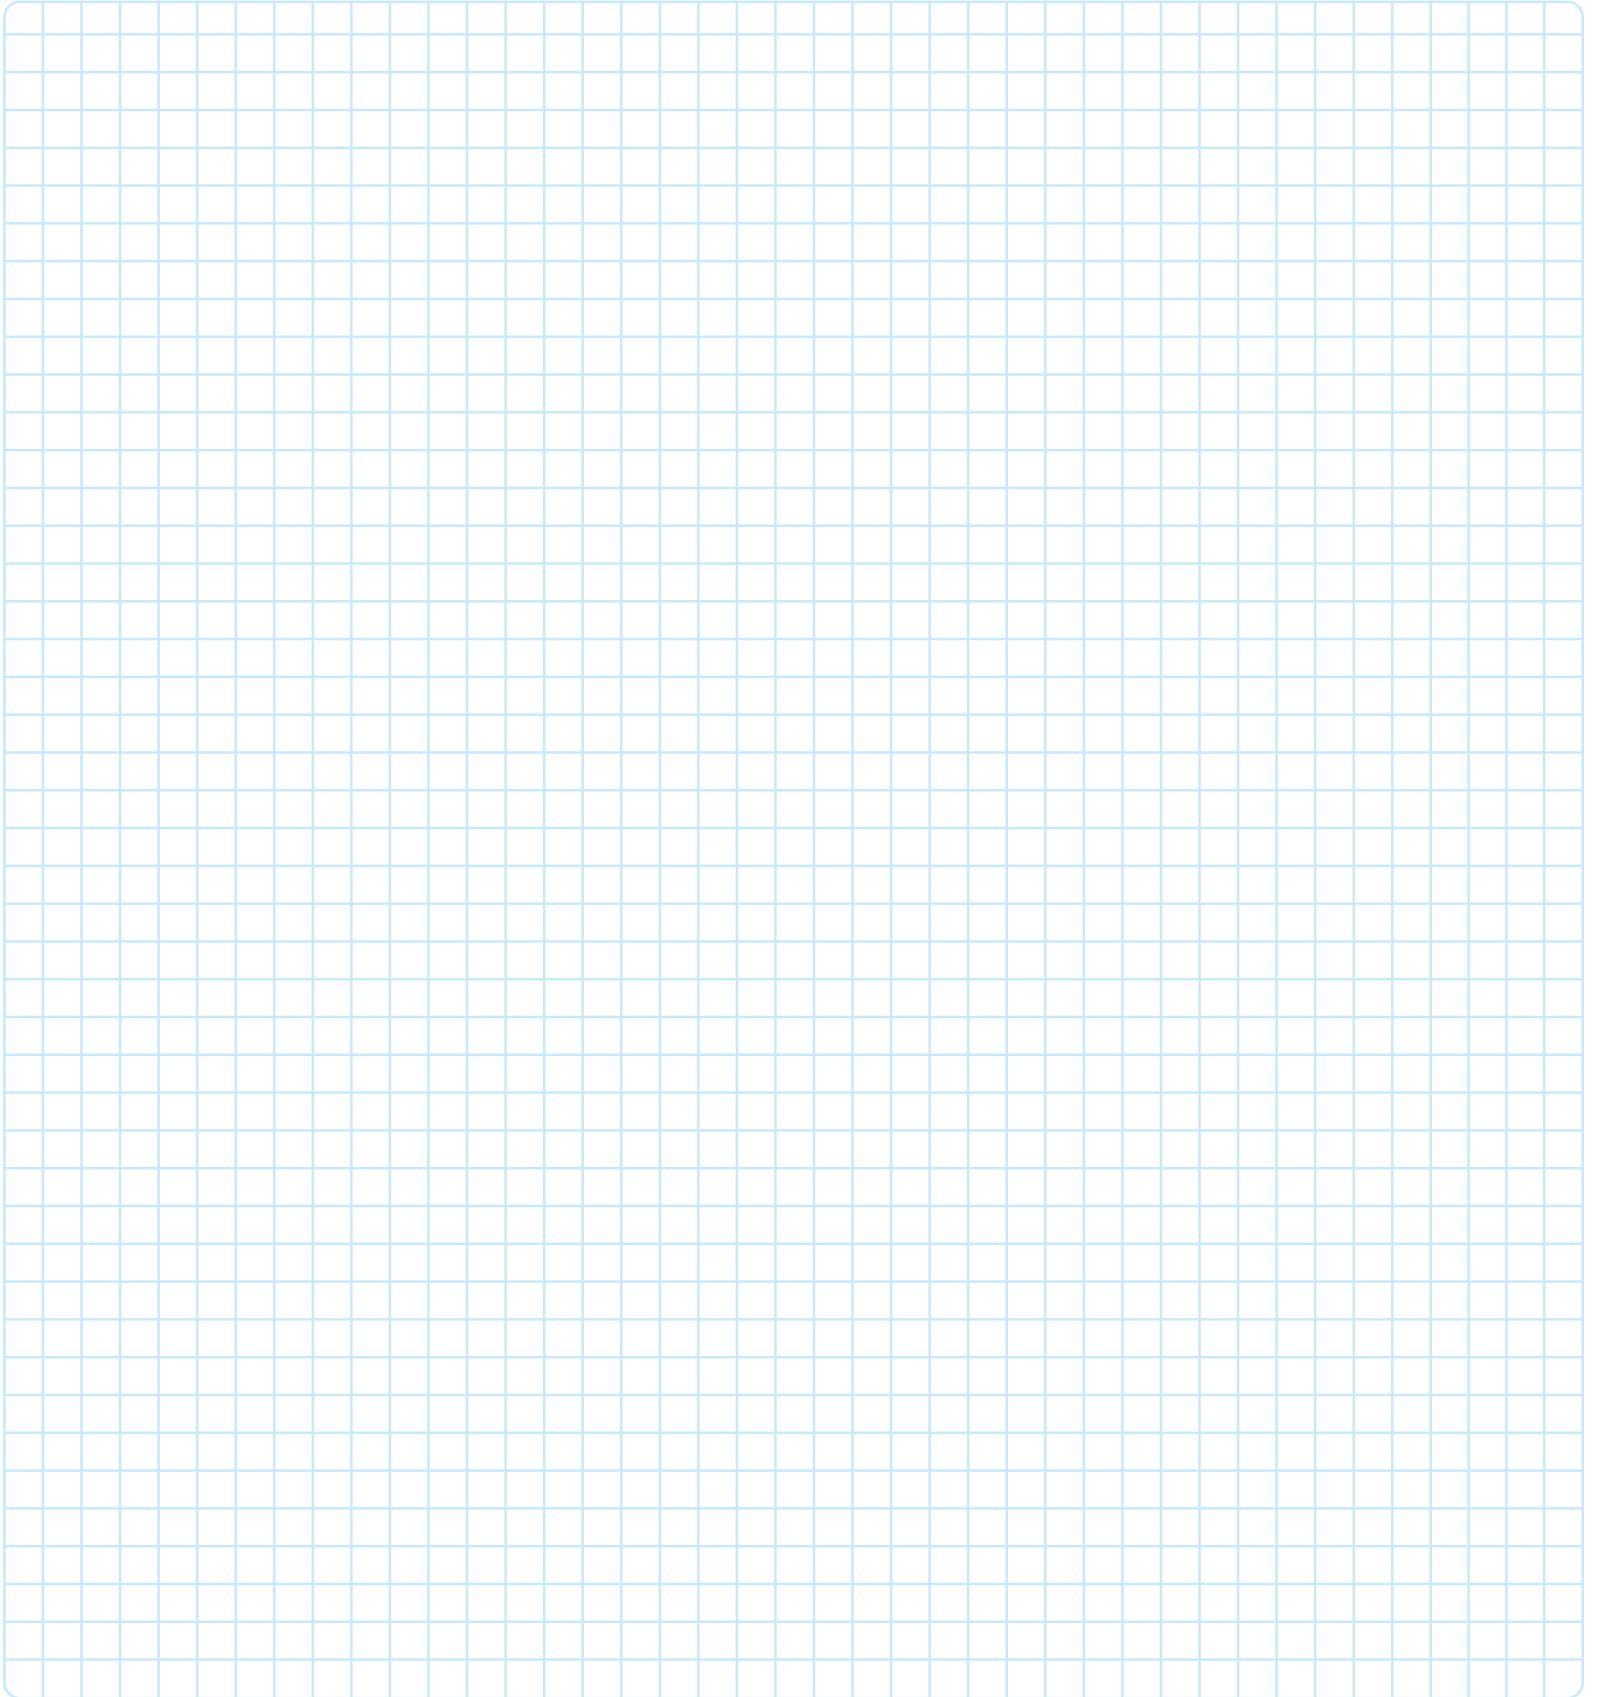

ZIEGLER INSTRUMENTS

Schnepfenreuther Weg 6, D-90425 Nurnberg, Germany.
Tel.: (+49)(911) 38 492 45
Fax.: (+49)(911) 32 26 212
E-mail: info@ziegler-instruments.com
Website: ziegler-instruments.com

Ziegler

Redefine Innovative Metering