

MICAR 2 Range


Measurement and instrumentation
Multi-function digital transducers
2 or 4 analogue outputs /Class 0.2



Local communication via optical head



Remote communication via Ethernet network

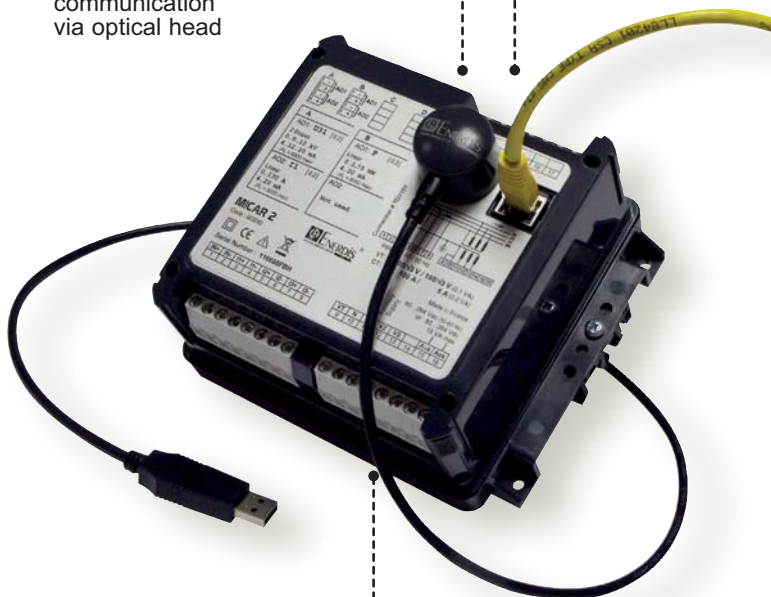

Simplified connection with screw-on terminal strip

PRODUCT ADVANTAGES

- + CLAss 0.2 Insulation 4 kv
- + Up to 4 ConFIGurABLE AnALogue outPUts
- + Option of 2 or 4 on-oFF outputs
- + CoMMunICAtion and programming via optical head or remotely via Ethernet network or RS485 output
- + eLeCtrICAL netWoRK suPeRVisIon and display of the energy values, harmonics and THD using the e.view+ software

General specifications

Quantities measured:
Choice of 1, 2, 3 or 4 among 32 electrical quantities
Configuration : in factory or by user with the E.view + software
Accuracy : Class 0.2
Current inputs : 1 A and 5 A
Voltage inputs : 100 to 400 V (ph-ph) or / 100 $\sqrt{3}$ to 400 $\sqrt{3}$ V (ph-N)
Transfer curves : linear 2 slopes, quadratic
Output signal : configurable between - 20 mA and + 20 mA
Response time : 350 ms
Operating frequency : 50 or 60 Hz
Auxiliary source with wide dynamic range: 80 to 264 V ac/dc or 19 to 57 Vdc
Compliance with CE directive

Electrical specifications

Voltage inputs	
Rated value	100 v ≤ Un ≤ 400 v (ph-ph) 57.7 ≤ vn ≤ 230 v (ph-N)
Frequency	50/60 Hz
Max .phase-to-phase voltage measured	650 kv (ph-ph)
Acceptable overvoltage	800 v for 24 hours .552 v permanent
Consumption	< 0.2 vA
Input impedance	2 MΩ
Current inputs	
Rated value (In)	1 A and 5 A
Max .current measured on primary	25,000 A
Acceptable overload	6.5 A permanent ,250 A for 1 second ,5 times every 5 minutes
Consumption	< 0.15 vA
Auxiliary power supply	
High level (standard)	80 to 265 vac /80 to 264 vdc (>15 vA)
Low level (option)	19.2 to 57 vdc
Pulse outputs or alarm relays	
Type	static relay
Operating voltage	24 to 110 vdc ± 20% 24 to 115 vac –10+ %15%
Max .current	100 mA
Compliance with standard	IEC 62053-31
Analogue output	
Scale	Configurable between –20 mA and +20 mA
Acceptable load	500 Ω, 10 v/I output
Typical response time	350 ms
RS 485 output	
Connection	2 wires ,half-duplex
Protocol	ModBus /JBus RTU mode
Speed (configurable)	2,400 –4,800 -9,600 –19,200 –38,400
Parity	even ,odd or none
JBus addresses	1 to 247
Ethernet output	
Type	RJ45 –8-pin
Protocol	ModBus/TCP
Speed (configurable)	Compatible with 10baseT

➤ Metrological specifications

➤ Analogue outputs

Type	Conditions	Accuracy class
-20+...20 mA	Measurement of I ,U ,v ,P ,S ,FP and F	Class 0.2 according to IEC 60688
	Measurement of Q	Class 0.5 according to IEC 60688

Digital communication output


Standard quantity	Conditions	Accuracy class
v	v between 10 %and 120 ⁽¹⁾ %of v _n	±0.2 %of v ±0.02 %of v _n
U	U between 10 %and 120 ⁽²⁾ %of U _n	±0.2 %of U ±0.02 %of U _n
I	I between 5 %and 130 %of I _n	±0.2 %of I ±0.02 %of I _n
F	F between 42.5 Hz and 69 Hz	±0.1 Hz
P	FP between 0.5 inductive and 0.8 capacitive • U between 99 % and 130 %of I _n	±0.2 %of P ±0.02 %of P _n
Q	FP between 0.5 inductive and– 0.5 capacitive • U between 99 %and 101 %of 5 %and 130 %of I _n	±0.5 %of Q ±0.05 %of Q _n
S	U between 99 %and 10 • I between 5 %and 130 %of I _n	±0.2 %of S ±0.02 %of S _n
FP ,Cosφ	FP between 0.5 inductive and 0.5 capacitive and 130 %of I _n	±0.02 counts

⁽¹⁾ v_n from 57.7 v to 230 v

⁽²⁾ U_n from 100 v to 400 v

Special quantity	Accuracy class
Active energy	Class 0.5s according to IEC 62053-22
Reactive energy	Class 2 according to IEC 62053-23
Apparent energy	±0.5%
THD-I ,THD-v and THD-U	±0.5 counts
Harmonics order by order on U ,v and I	±0.5 counts

➤ Dimensions

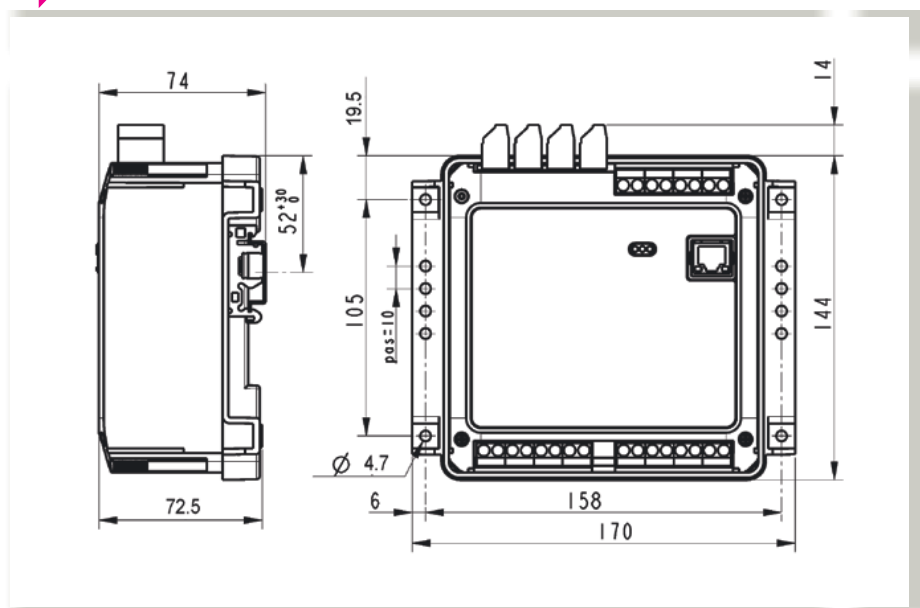

➤ Environmental specifications

➤ Mounting accessories

Climate specifications	
Operating temperature	-10°C to +55°C
Operating humidity	95 %at 40°C
Storage temperature	-25°C to +70°C
Safety specifications	
Degree of pollution	2
Behaviour in fire	UL94 ,severity v1
Installation category	3
Mechanical specifications	
Protection rating	Ip51 on front panel and IP20 on rear panel
Mechanical shocks	IEC 61010-1
vibrations	IEC 60068-2-6 (method A)
Free fall with packaging	NF H 0042-1
Electromagnetic compatibility	
Generic standard	IEC 61326-1

Weight	700 g
Mounting	DIN 43700 rail or platen
Connection	Screw terminals for 6 mm ² rigid or flexible wires on current measurement inputs and 2.5 mm ² for the other accesses

➤ Functions


Measurement	On-off output				
	Analogue output	Alarm relay	Pulse output	Communication output	Display with E.view+
v1 ,v2 ,v3 ,vearth	•	•		•	•
U12 ,U23 ,U31	•	•		•	•
I1 ,I2 ,I3 ,In	•	•		•	•
P1 ,P2 ,P3	•			•	•
Pt	•	•		•	•
Q1 ,Q2 ,Q3	•			•	
Qt		•		•	•
S1 ,S2 ,S3	•			•	
St		•		•	•
FP1 ,FP2 ,FP3	•			•	
FPt		•		•	
Cos1 ,Cosφ2 ,Cos φ3 ,	•			•	
Cos t		•		•	
Frequency		•		•	•
Crest factor v1 ,v2 ,v3				•	•
Crest factor I1 ,I2 ,I3				•	•
Unbalance U				•	•
Harmonics :v1 ,v2 ,v3 ,U12 ,U23 ,U31 ,I1 ,I2 ,I3				•	•
THD :v1 ,v2 ,U12 ,U23 ,U31 ,I1 ,I3				•	•
Active energy :receiver ,generator			•	•	•
Reactive energy :Qcad1 ,Qcad2 ,Qcad3 ,Qcad4			•	•	•
Apparent energy :receiver ,generator			•	•	•

➤ Electrical connections


Configurations for single-phase networks

$I_1, v_1, P_1, S_1, Q_1, FP_1, \cos\phi_1, F:$

TD301 configuration

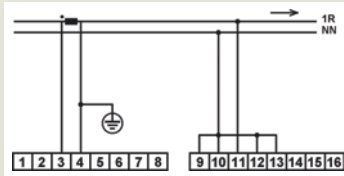


TD302 configuration

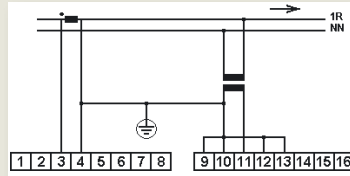


Balanced 3-phase network with 4 wires

$I_1, I_2, I_3, v_1, v_2, v_3, P_1, P_2, P_3, Pt, S_1, S_2, S_3, St, Q_1, Q_2, Q_3, Qt, FP_1, FP_2, FP_3, FPt, \cos\phi_1, \cos\phi_2, \cos\phi_3, \cos\phi_t, F:$

TD303 configuration

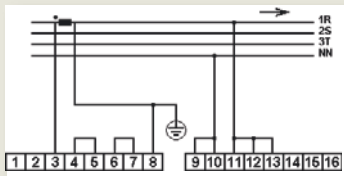


TD304 configuration

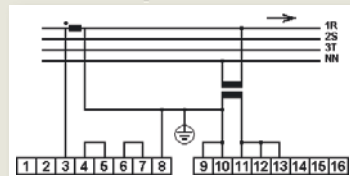


Unbalanced 3-phase network with 3 wires

$I_1, I_2, I_3, U_{12}, U_{23}, U_{31}, P_1, P_2, P_3, Pt, S_1, S_2, S_3, St, Q_1, Q_2, Q_3, Qt, FP_1, FP_2, FP_3, FPt, \cos\phi_1, \cos\phi_2, \cos\phi_3, \cos\phi_t, F:$


TD320 configuration

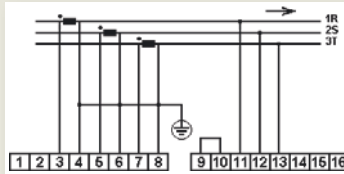


TD320D configuration

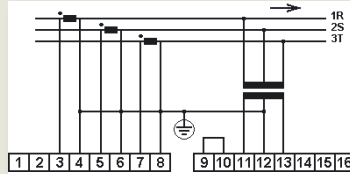


TD320Y configuration

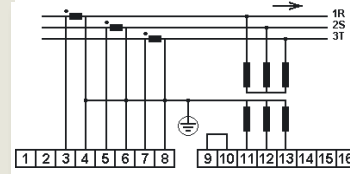

TD324 configuration

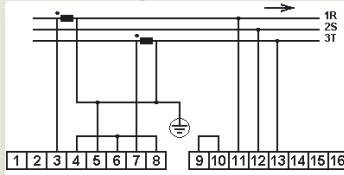


TD324D configuration

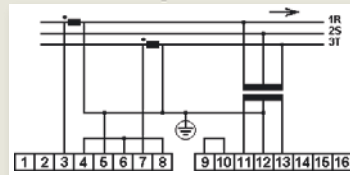


$I_1, I_2, I_3:$

TD322 configuration

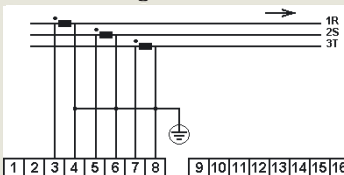


TD323 configuration

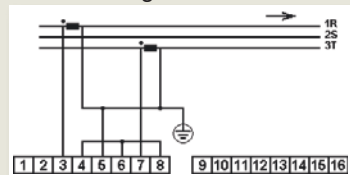


U12 ,U23 ,U31:

TD321 configuration

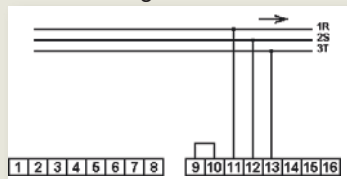


TD321D configuration

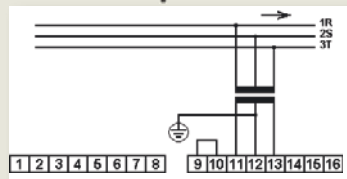


Unbalanced 3 phase network with 4 Wires

I1 ,I2 ,I3:


TD314 configuration

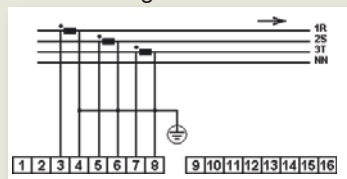

v1 ,v2 ,v3 ,U12 ,U23 ,U31
Td317 configuration

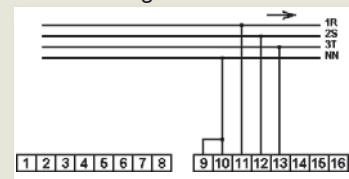


TD317Y configuration

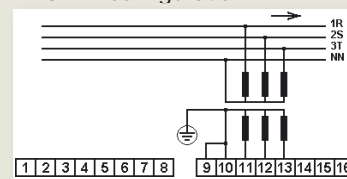


I1 ,I2 ,I3 ,Ineutral:

TD334 configuration

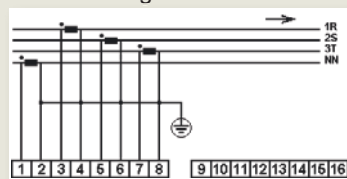


v1 ,v2 ,v3 ,vearth ,U12 ,U23 ,U31 ,F:

TD337 configuration

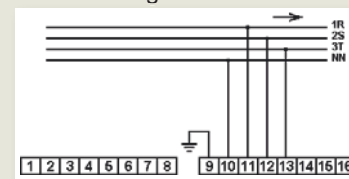


TD337Y configuration

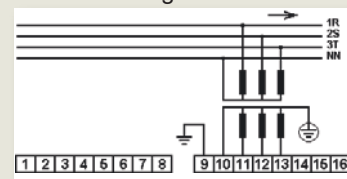


I1 ,I2 ,I3 ,v1 ,v2 ,v3 ,U12 ,U23 ,U31 ,P1 ,P2 ,P3 ,Pt ,S1 ,S2 ,S3 ,St ,Q1 ,Q2 ,Q3 ,Qt ,FP1 ,FP2 ,FP3 ,FPt ,Cosφ1 ,Cosφ2 ,Cosφ


TD315 configuration

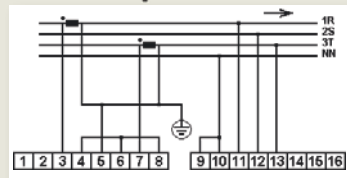


TD315Y configuration

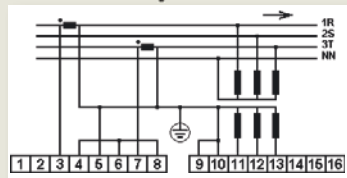

TD318 configuration

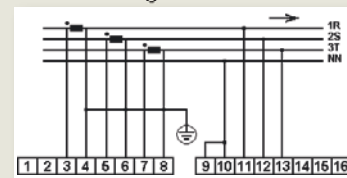


TD318Y configuration

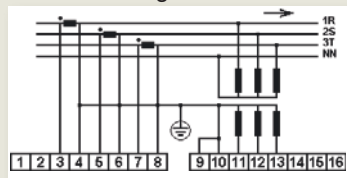


I1 ,I2 ,I3 ,Ineutral ,v1 ,v2 ,v3 ,vterre ,U12 ,U23 ,U31 ,P1 ,P2 ,P3 ,Pt ,S1 ,S2 ,S3 ,St ,Q1 ,Q2 ,Q3 ,Qt ,FP1 ,FP2 ,FP3 ,FPt ,Cosφ1 ,Cosφ2 ,Cosφ3 ,Cosφt ,F:


TD338 configuration

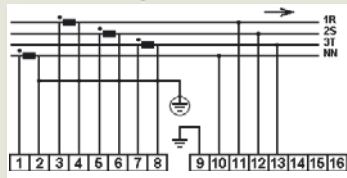

TD338Y configuration

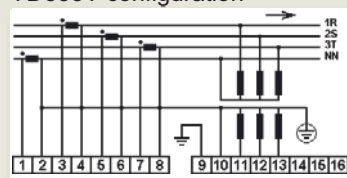


The E.view +software can be used with the **MICAR 2 range for configuration ,installation diagnosis and display of the electrical quantities.**

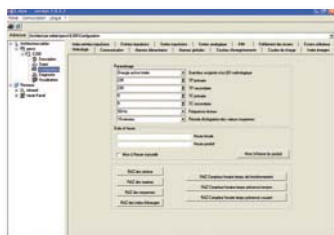


Configuration

- Configure your MICAR 2 transducers remotely via the RS485 ,Ethernet or local area network using the optical head
- Program the products 'communication parameters and the configuration parameters (CT ratio ,VT ,alarm thresholds ,etc.)

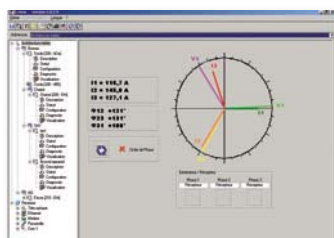

Diagnosis

- View the phase order and the Fresnel diagram

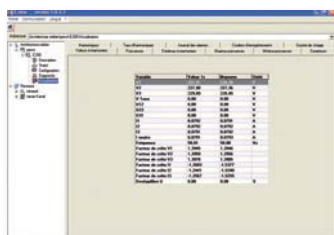

Display

- View the basic electrical quantities in real time
- View the harmonics in histogram format

TO Order

Product	Code
MICAR with tailored configuration	Complete the order form
Programmable MICAR 2 ,power supply 80-264 v AC/DC ,RS485 ,2 analogue outputs (without programming kit)	P01 330 840
Programmable MICAR 2 ,power supply 80-264 v AC/DC ,RS485 ,4 analogue outputs (without programming kit)	P01 330 841
Programming kit	Code
MICAR 2 –RS485 kit containing 1 optical head +1 set of 50 labels +RS485 output +1 E.view +CD	P01 330 842
MICAR 2 –Ethernet kit containing 1 optical head +1 set of 50 labels +Ethernet output +1 E.view +CD	P01 330 843
Accessories	Code
Set of 50 labels for RS485 output	P01 330 844
Set of 50 labels for Ethernet output	P01 330 845

* labels printable only on laser printers

➤ Associated products

Analogue panel meters



Digital panel meters



CT Current transformers



E.view +software



1 –Network

- ☐ Single-phase ☐ Unbalanced 3-phase ,3 wires
- ☐ Balanced 3-phase ,3 wire ☐ Unbalanced 3-phase ,4 wires
- ☐ Balanced 3-phase ,4 wires

2 –Frequency

- ☐ 50 Hz
or
☐ 60 Hz

3 –Connection options

- ☐ Ethernet (no RS485) ☐ Tropicalization
- ☐ 2 on-off outputs or ☐ 4 on-off outputs
- Connection configuration : TD

4 -Power supply

- ☐ 80 to 265 vac(50/60 Hz) / 80 to 264 vdc or 19 to 57 vdc ☐

5 –Inputs

Current

With current transformer or Direct

Primary Secondary A A

voltage

With voltage transformer or Direct

Primary Secondary v v

- ☐ Phase-phase ☐ Phase-neutral

Quantities available

v1 v2 v3 vearth U12 U23 U31 I1 I2 I3 Ineutral P1 P2 P3 Pt Q1 Q2 Q3 Qt S1 S2 S3 St

FP1 FP2 FP3 FPt COSφ COSφ2 COSφ3 COSφt F

Output 1

Quantity and measurement range (x)

Indicate the quantity to be measured

Min Breaking point Max Unit⁽¹⁾

Transfer curve

- ☐ Linear
- ☐ 2 slopes
- ☐ Quadratic

Output signal (y)

Min Breaking point Max mA

Output 2

Quantity and measurement range (x)

Indicate the quantity to be measured

Min Breaking point Max Unit⁽¹⁾

Transfer curve

- ☐ Linear
- ☐ 2 slopes
- ☐ Quadratic

Output signal (y)

Min Breaking point Max mA

Output 3

Quantity and measurement range (x)

Indicate the quantity to be measured

Min Breaking point Max Unit⁽¹⁾

Transfer curve

- ☐ Linear
- ☐ 2 slopes
- ☐ Quadratic

Output signal (y)

Min Breaking point Max mA

Output 4

Quantity and measurement range (x)

Indicate the quantity to be measured

Min Breaking point Max Unit

Transfer curve

- ☐ Linear
- ☐ 2 slopes
- ☐ Quadratic

Output signal (y)

Min Breaking point Max mA

FRANCE

Enerdis
1-9 ,rue d'Arcueil -BP 675
92542 MONTROUGE Cedex
Tel+ :33 1 47 46 78 85
Fax+ :33 1 47 35 01 33
export@enerdis.fr
www.enerdis.fr

UNITED KINGDOM

Chauvin Arnoux Ltd
Waldeck House - Waldeck Road
MAIDENHEAD SL6 8BR
Tel+ :44 1628 788 888
Fax+ :44 1628 628 099
info@chauvin-arnoux.co.uk
www.chauvin-arnoux.co.uk

MIDDLE EAST

Chauvin Arnoux Middle East
P.O .BOX 60-154
1241 2020 JAL EL DIB)BEIRUT(
Tel+ :961 1 890 425
Fax+ :961 1 890 424
camie@chauvin-arnoux.com
www.chauvin-arnoux.com



**CHAUVIN
ARNOUX**
GROUP